


CROSS-OVER & BAFFLE DETAIL

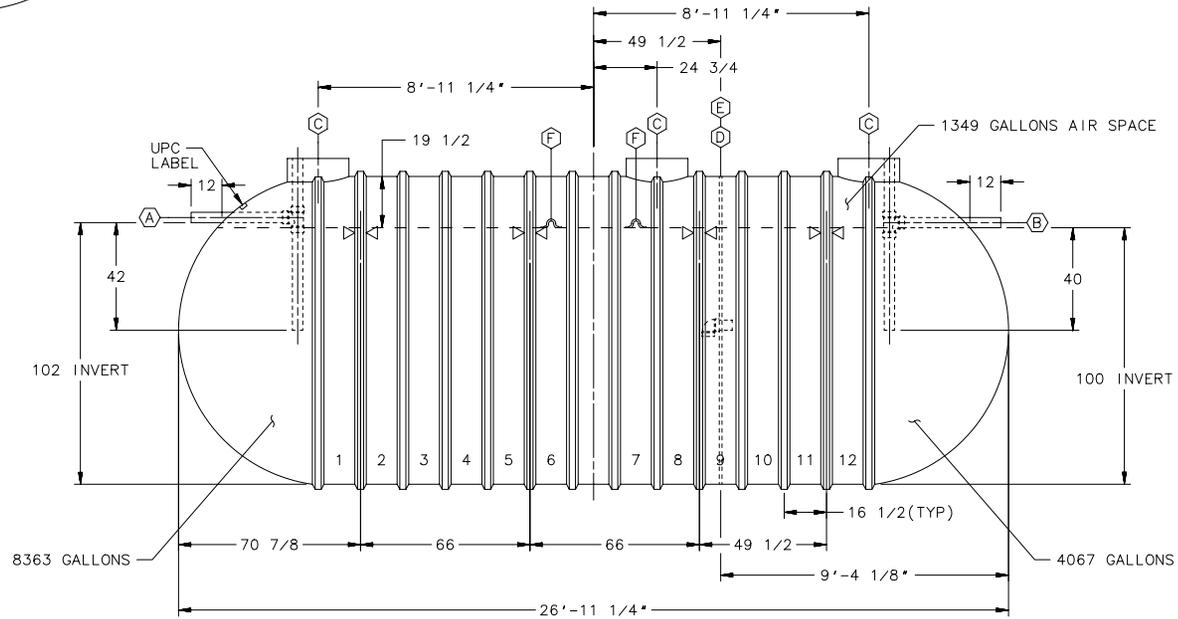


NOTE:

1 - UPC LABEL IS LAMINATED ONTO INLET SIDE OF TANK.

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of Minnesota

John R. Burwell

Date \_\_\_\_\_ Reg. No. 24679

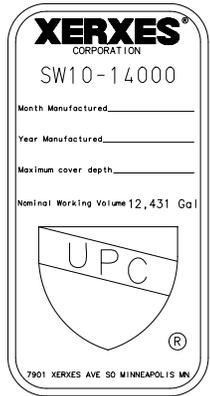

(A)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC INLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(B)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC OUTLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(C)	RISER PIPE, FOR 24*(NOMINAL) ACCESS OPENING
(D)	FULL PLATE BAFFLE WITH 1-4 5/8" DIA HOLE (59 3/4" INVERT) & 4" DIA VENT HOLE
(E)	4"DIA SCH 40 PVC CROSS-OVER ELBOW & PIPE
(F)	LIFTING LUG (2 LUGS AT EACH LOCATION, 4 TOTAL)
(X)	HOLD DOWN STRAP LOCATION

0	REVISION DESCRIPTION	BY DATE
DATE	DATE	DATE
<b>XERXES CORPORATION</b>		
DR: DAG	DATE: 7-19-06	TITLE: 10" DIA SWT
CR: D	DATE:	CAP: 14,000 GALLONS
SIB: D	DATE:	IAPMO
APPR: JB	DATE: 7-25-06	DR: SIBS DR: HANSEN
SCALE: 1/2"=1'-0"	NEXT ASS'Y:	REV: D 628-346 00
		REV: 1 OF 1