


CROSS-OVER & BAFFLE DETAIL

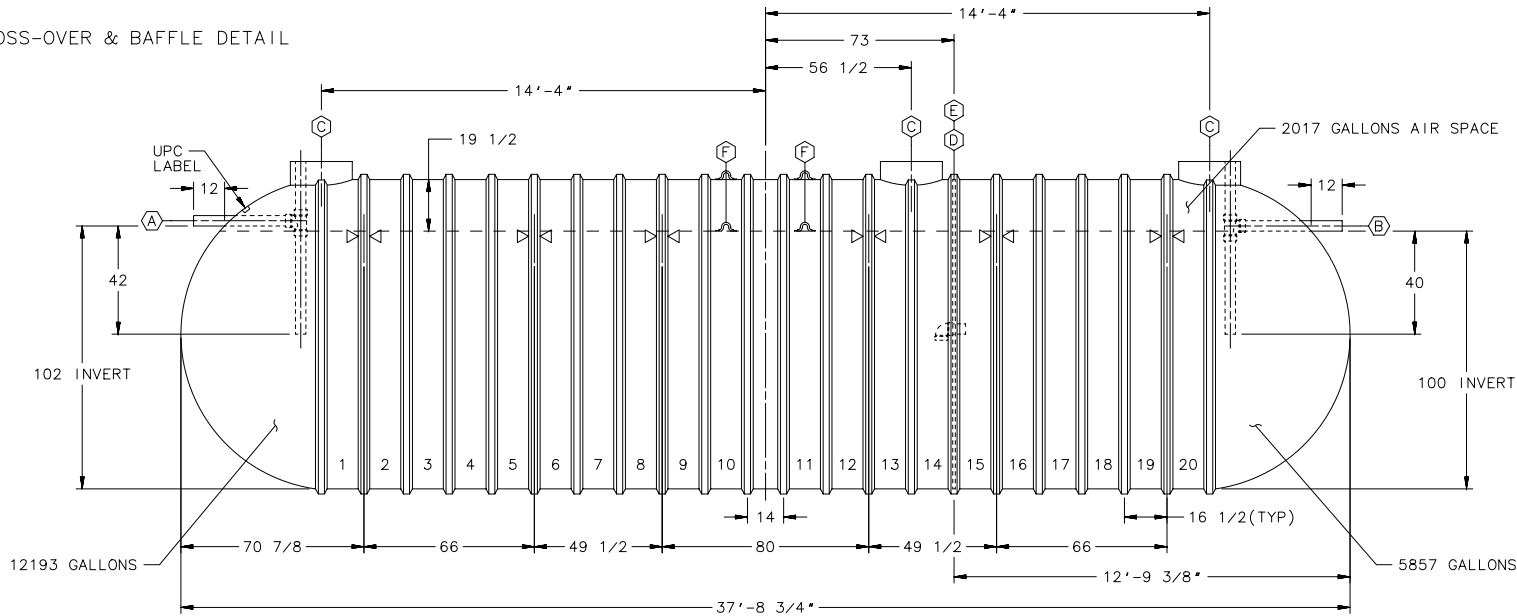


NOTE:

1 - UPC LABEL IS LAMINATED ONTO INLET SIDE OF TANK.

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of Minnesota

John R. Burwell

Date _____ Reg. No. 24679

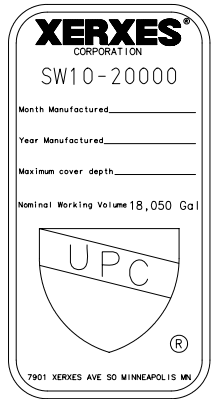

(A)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC INLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(B)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC OUTLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(C)	RISER PIPE, FOR 24*(NOMINAL) ACCESS OPENING
(D)	FULL PLATE BAFFLE WITH 1-4 5/8" DIA HOLE (59 3/4" INVERT) & 4" DIA VENT HOLE
(E)	4"DIA SCH 40 PVC CROSS-OVER ELBOW & PIPE
(F)	LIFTING LUG (2 LUGS AT EACH LOCATION, 4 TOTAL)
(X)	HOLD DOWN STRAP LOCATION

0		REVISION DESCRIPTION		BY DATE	
CR'D	DATE	STP'S	DATE	APP'D	DATE
		TITLE 10" DIA SWT CAP. 20,000 GALLONS IAPMO			
DR	DATE	DR	DATE	DR	DATE
DAG	7-19-06				
STP'S	DATE	DR	DATE	DR	DATE
		D	7-25-06		
APP'D	DATE	DR	DATE	DR	DATE
JB	7-25-06				
SCALE	1/2"=1'-0"	NEXT ASS'Y		REV	
					SH 1 OF 1