


NOTE:

1 - UPC LABEL IS LAMINATED ONTO INLET SIDE OF TANK.



I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of Minnesota

John R. Burwell

Date _____ Reg. No. 24679

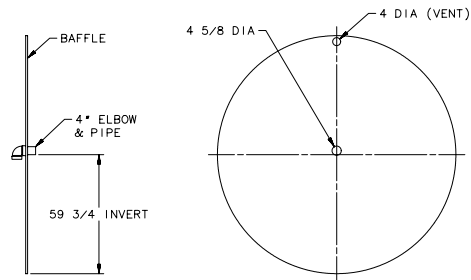

CROSS-OVER & BAFFLE DETAIL

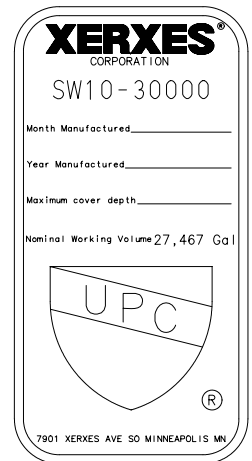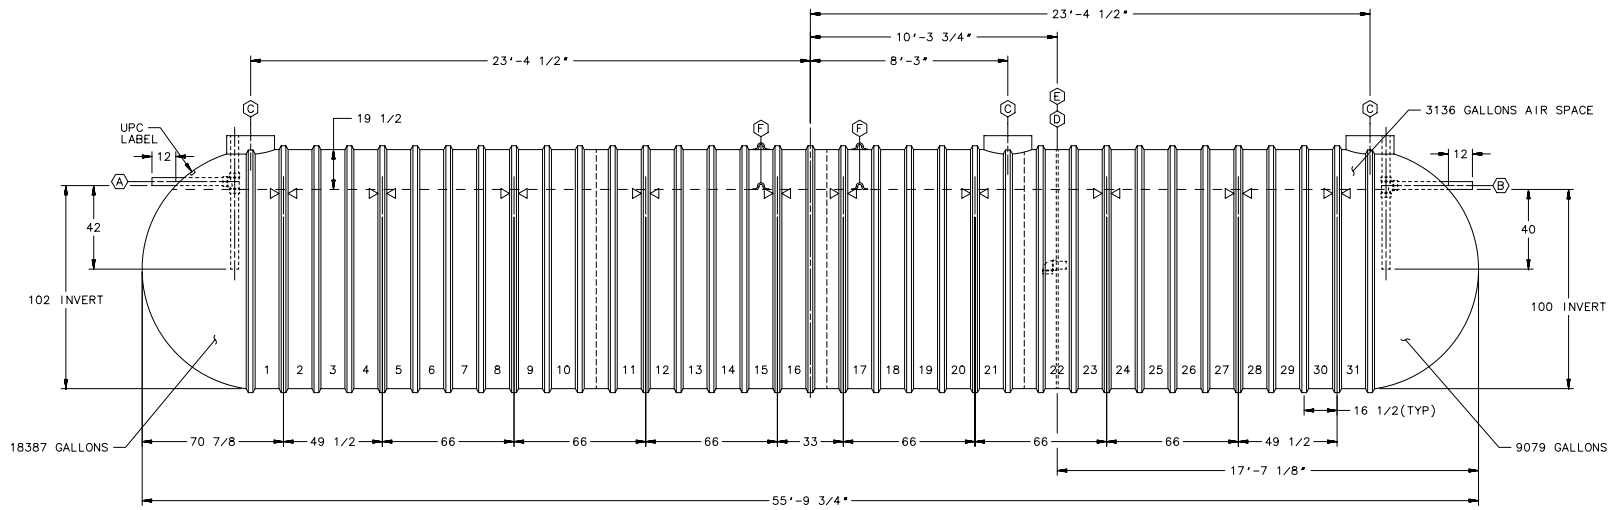

(A)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC INLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(B)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC OUTLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(C)	RISER PIPE, FOR 24"(NOMINAL) ACCESS OPENING
(D)	FULL PLATE BAFFLE WITH 1-4 5/8" DIA HOLE (59 3/4" INVERT) & 4" DIA VENT HOLE
(E)	4"DIA SCH 40 PVC CROSS-OVER ELBOW & PIPE
(F)	LIFTING LUG (2 LUGS AT EACH LOCATION, 4 TOTAL)
(X)	HOLD DOWN STRAP LOCATION

REVISION DESCRIPTION						BY DATE
0	-	-	-	-	-	-
DRK'D	DATE	STD'S	DATE	APPR'D	DATE	
-	-	-	-	-	-	
XERXES CORPORATION			TITLE 10"DIA SWT CAP. 30,000 GALLONS IAPMO			
			DR. SIZE DR. NUMBER	REV		
DR. DAG	DATE 7-19-06			E	628-336	00
DRK'D	DATE					
STD'S	DATE					
APPR'D	DATE 7-25-06					
JB						
SCALE: 1/2"=1'-0"		NEXT ASS'Y: -		SHT 1 OF 1		