


CROSS-OVER & BAFFLE DETAIL

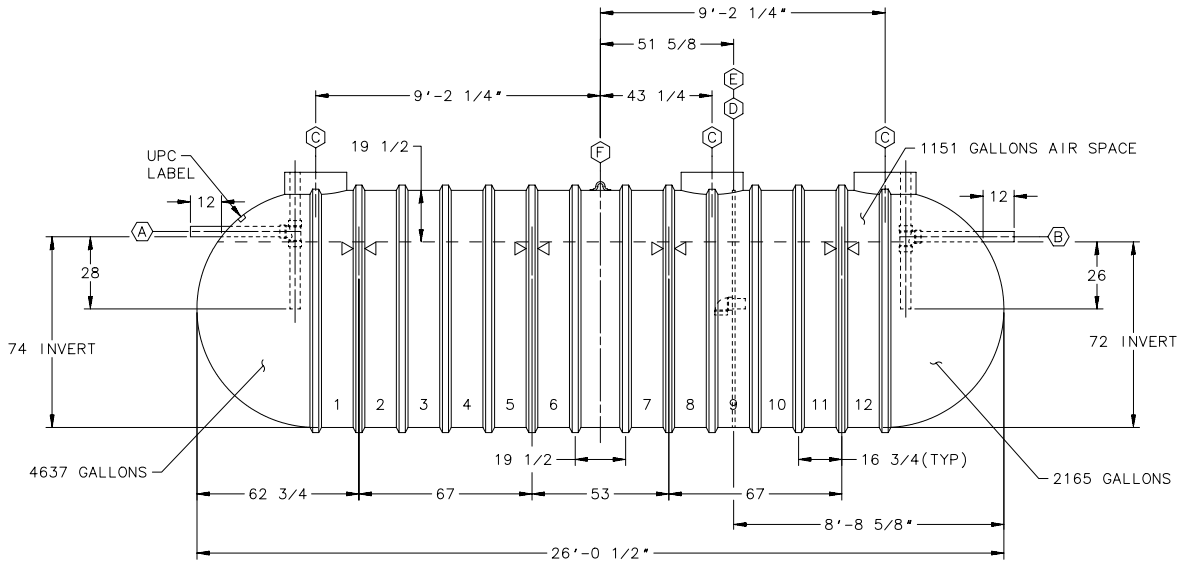

(A)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC INLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(B)	4"DIA, 6"DIA OR 8"DIA SCH 40 PVC OUTLET PIPE WITH INTERNAL SANITARY TEE & PIPES
(C)	RISER PIPE, FOR 24*(NOMINAL) ACCESS OPENING
(D)	FULL PLATE BAFFLE WITH 1-4 5/8" DIA HOLE (45 3/4" INVERT) & 4" DIA VENT HOLE
(E)	4"DIA SCH 40 PVC CROSS-OVER ELBOW & PIPE
(F)	LIFTING LUG
☒	HOLD DOWN STRAP LOCATION


NOTE:

1 - UPC LABEL IS LAMINATED ONTO INLET SIDE OF TANK.

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Registered Professional Engineer under the laws of the State of Minnesota

John R. Burwell

Date _____ Reg. No. 24679

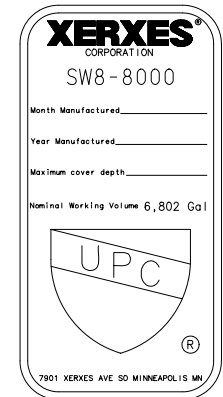

3 MOVE UPC LABEL						DAG
CRK'D	DATE	STP'S	DATE	APPR'D	DATE	6-7-06
-	-	-	-	JB	-	6-7-06
2 ADD ACCESS OPENING TO RIB 8/9						DAG
CRK'D	DATE	STP'S	DATE	APPR'D	DATE	6-7-06
-	-	-	-	JB	-	6-7-06
1 ADD UPC LABEL & CAPACITY DATA						DAG
CRK'D	DATE	STP'S	DATE	APPR'D	DATE	4-26-06
-	-	-	-	JB	-	4-27-06
XERXES CORPORATION						
DR	DATE	TITLE		REV		
DAG	4-10-06	8"DIA SWT				
CRK'D	DATE	CAP. 8,000 GALLONS				
		IAPMO				
STP'S	DATE	DR	SIZES	OR	NUMBER	REV
APPR'D	DATE	D	627-768			03
JB	4-12-06					
SCALE: 1/2"=1'-0"						NEXT ASS'Y: -
						SHT 1 OF 1