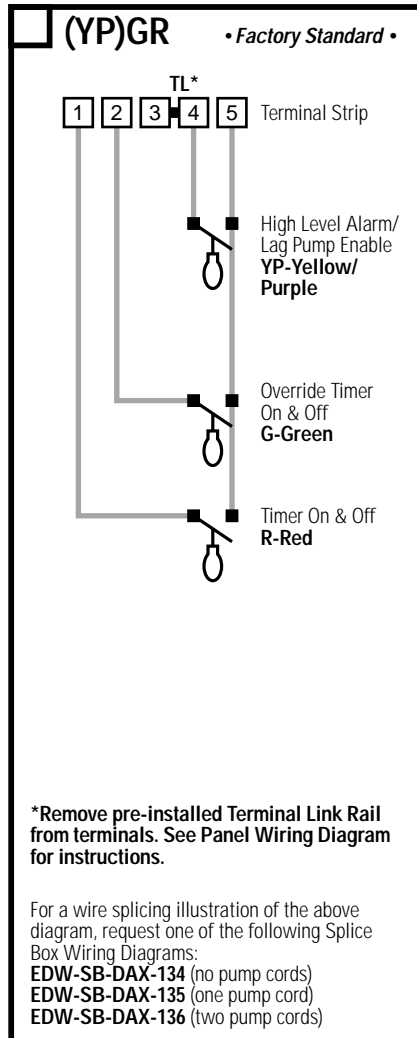# Float Arrangement Diagram

OSI

Orenco Systems®
Incorporated

Check the appropriate box for the float function (color code) used in your system.

☐ **(YP)GR** • *Factory Standard* •

TL*

| 1 | 2 | 3 | 4 | 5 | Terminal Strip

High Level Alarm/
Lag Pump Enable
**YP-Yellow/
Purple**

Override Timer
On & Off
G-Green

Timer On & Off
R-Red

***Remove pre-installed Terminal Link Rail
from terminals. See Panel Wiring Diagram
for instructions.**

For a wire splicing illustration of the above
diagram, request one of the following Splice
Box Wiring Diagrams:
EDW-SB-DAX-134 (no pump cords)
EDW-SB-DAX-135 (one pump cord)
EDW-SB-DAX-136 (two pump cords)

Float Types

■ **Typical OSI float model:** A
Specs: contact - normally open
differential - no minimum
power rating - signal
Possible substitutions: B,C,D

Control Panel Series

MVP-DAX PT

Drawing No.

EDW-FA-DAX-22

EDW-FA-DAX-22
Rev 2.0 © 02/14/01