


Panel Wiring Diagram Model MVP-DAX2 DM



814 AIRWAY AVENUE
SUTHERLIN, OREGON
97479-9012

TELEPHONE:
(800) 348-9843
(541) 459-4449



WEBSITE:
www.orenco.com

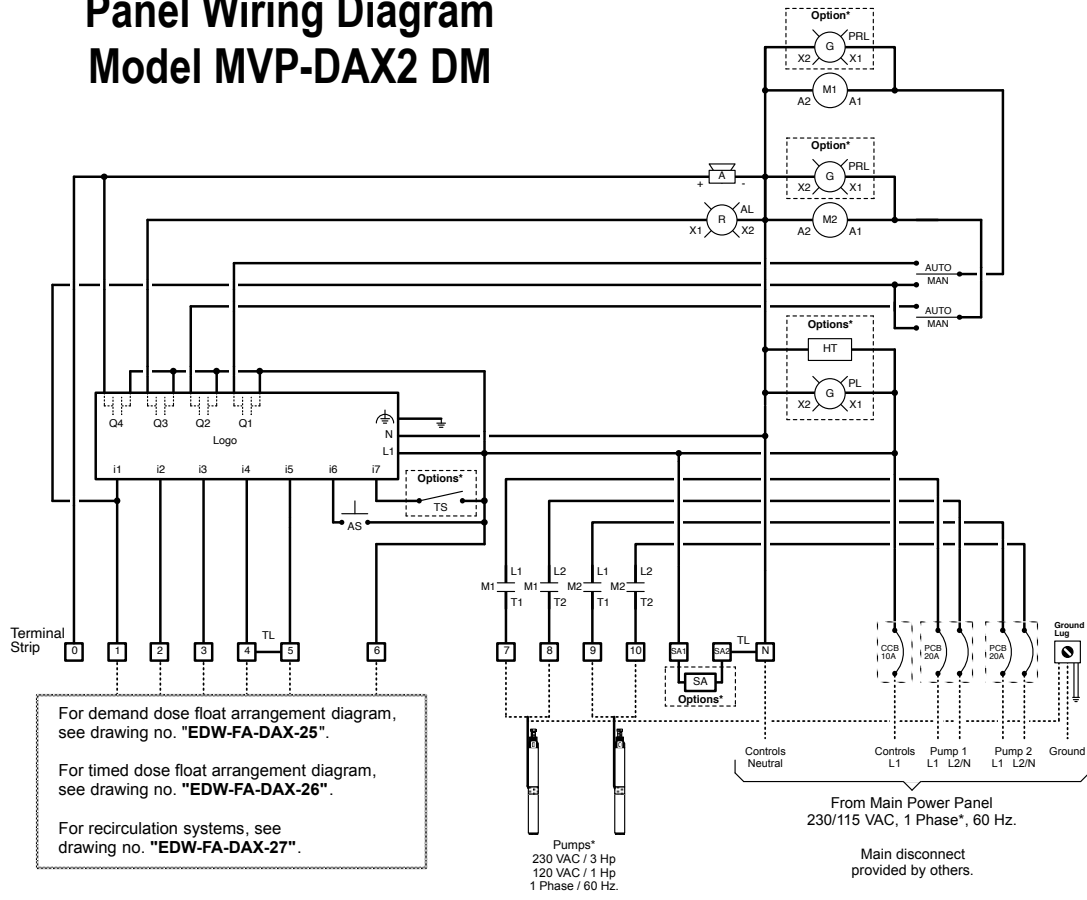

For demand dose float arrangement diagram, see drawing no. "EDW-FA-DAX-25".

For timed dose float arrangement diagram, see drawing no. "EDW-FA-DAX-26".

For recirculation systems, see drawing no. "EDW-FA-DAX-27".

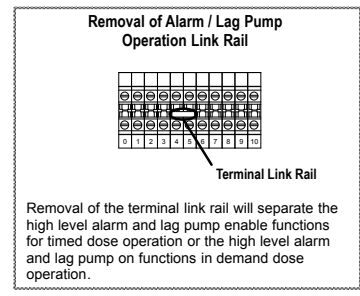

- ### Key
- = Factory Wire
 - ⋯ = Field Wire
 - - - = Alternate Field Wire
 - A = Audio Alarm, 115 VAC
 - AL = Alarm Light
 - AS = Audio Silence Switch
 - CCB = Controls Circuit Breaker
 - Logo = Logic Module
 - M = Motor Contactor
 - PCB = Pump Circuit Breaker
 - TL = Terminal Link
- ### *Options
- HT = Heater
 - PL = Power Light
 - PRL = Pump Run Light
 - SA = Surge Arrestor
 - TS = Test Switch

For MVP-DAX DM operation description, see drawing no. "EIN-CP-OP-2042".

